


APOLLO bassano vertical technical specification

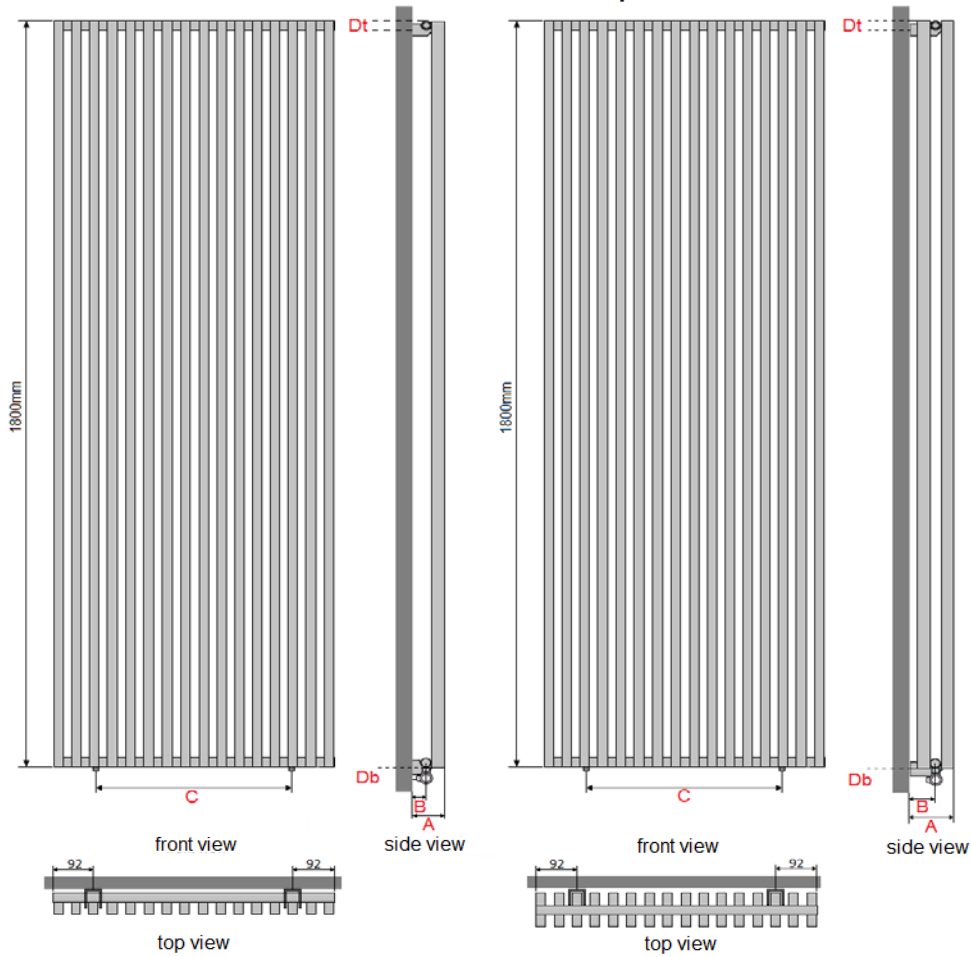

BASSANO VERTICAL SINGLE DIMENSIONS (mm)			
MODEL HEIGHT			1800
Width of radiator		304 464 624	
No. of tubes		8 12 16	
Section depth x width			45 x 20
Nominal width			No. of tubes x 40 - 16
Back wall to front of rad		(A)	118
Back wall to pipe centres	Side entry		N/A
	Bottom entry	(B)	54
Tapping centres	Side entry		N/A
	Bottom entry	(C)	240 400 560
Bracket positions	Top	(Dt)	17.5
	Bottom	(Db)	0
Tappings			1/2"

BASSANO VERTICAL DOUBLE DIMENSIONS (mm)			
MODEL HEIGHT			1800
Width of radiator		304 464 624	
No. of tubes		8 (x2) 12 (x2) 16 (x2)	
Section depth x width			45 x 20
Nominal width			No. of tubes x 40 - 16
Back wall to front of rad		(A)	166
Back wall to pipe centres	Side entry		N/A
	Bottom entry	(B)	103
Tapping centres	Side entry		N/A
	Bottom entry	(C)	240 400 560
Bracket positions	Top	(Dt)	17.5
	Bottom	(Db)	0
Tappings			1/2"

ADDITIONAL INFORMATION	
Material	Steel
Alloy thickness	1.2mm
Maximum working pressure	4 bar/400 kPa
Mechanical strength test pressure	7 bar/700 kPa
Maximum working temperature	110°C

BASSANO VERTICAL SINGLE WEIGHTS & VOLUMES (per radiator)			
Model width (mm)		304	464 624
Dry weight (A) Kg		23.20	34.80 46.40
Water content (B) Litres		10.64	15.96 21.28
Working weight (A+B) Kg		33.84	50.76 67.68
Outputs: Watts ΔT=50k		859	1289 1719

The thermal outputs expressed at ΔT=50k comply with European regulation EN 442-2

BASSANO VERTICAL DOUBLE WEIGHTS AND VOLUMES (per radiator)			
Model width (mm)		304	464 624
Dry weight (A) Kg		45.12	67.68 90.24
Water content (B) Litres		20.64	30.96 41.28
Working weight (A+B) Kg		65.76	98.64 131.52
Outputs: Watts ΔT=50k		1379	2068 2758

The thermal outputs expressed at ΔT=50k comply with European regulation EN 442-2

TEMPERATURE			
FACTORS FOR DIFFERENCES BETWEEN MEAN WATER TEMPERATURE AND ROOM TEMPERATURE IN °C AND °F OTHER THAN 50°C (90°F)			
5°C	0.050		
10°C	0.123	10°F	0.057
15°C	0.209	20°F	0.142
20°C	0.304	30°F	0.240
25°C	0.406	40°F	0.348
30°C	0.515	50°F	0.466
35°C	0.629	60°F	0.590
40°C	0.748	70°F	0.721
45°C	0.872	80°F	0.858
50°C	1.000	90°F	1.000
55°C	1.132	100°F	1.147
60°C	1.267	110°F	1.298
65°C	1.406	120°F	1.454
70°C	1.549	130°F	1.613
75°C	1.694	140°F	1.776

TO APPLY THE FACTORS SHOWN IN THE TABLE TO OUR QUOTED OUTPUTS.

MULTIPLY THE QUOTED OUTPUT BY THE CHOSEN OPERATING FACTOR TO GIVE THE OUTPUT